



# Metal Building Insulation Energy Code Compliance Guide

Depending on what building code has been adopted and is enforced in the jurisdiction where the site is located, metal buildings usually have to meet the insulation requirements of either:

1. ASHRAE Standard 90.1, or
2. The ICC International Energy Conservation Code (IECC)


While both ASHRAE 90.1 and the IECC use the same climate zone map for the U.S. (see Figure 1), the insulation requirements in each climate zone for the two documents vary. In addition, both ASHRAE 90.1 and the IECC provide two compliance paths – “performance” (max. assembly U-factor) and “prescriptive” (min. insulation R-value).

The requirements for those paths are listed in Tables 1 and 2, for both roof and wall assemblies. NOTE: for the specific requirements currently adopted in each state go to: <http://bcap-ocean.org/code-status-commercial>

In addition, the calculated U-factors for some typical wall and roof assemblies, using Owens Corning’s Certified R, OptiLiner® and ELAMINATOR® metal building insulation products and systems, are provided in Tables 3 and 4.

**Figure 1**

ICC/ASHRAE Climate Zone Map

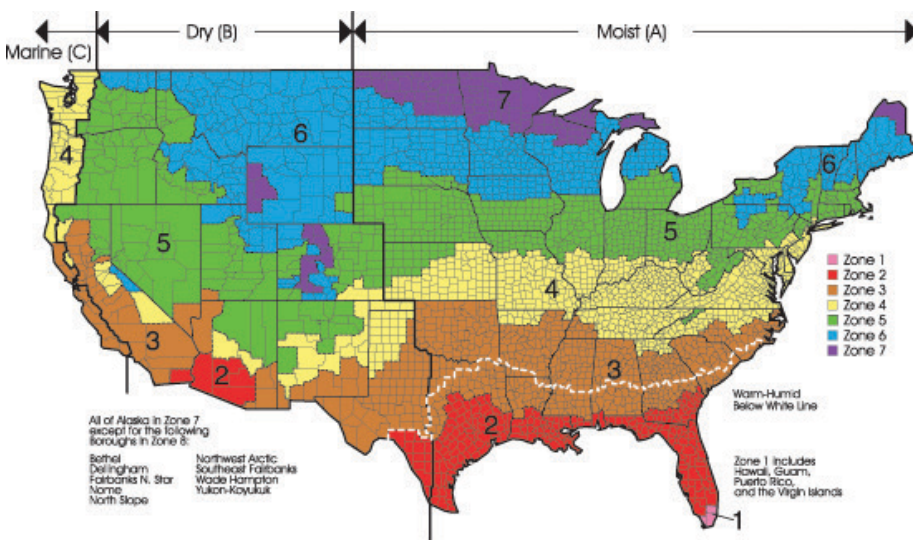

**Table 1 - Roof Assembly Requirements**

Climate Zone	ASHRAE 90.1											IECC						
	Nonresidential (conditioned)						Semiheated					Metal Building Walls (Above Grade)						
	Assembly U-factor			Insulation R-value			Assembly U-factor			Insulation R-value		Assembly U-factor		Insulation R-value				
	2010	2013	2016	2010	2013	2016	2010	2013	2016	2010	2013	2016	2009	2012/2015	2009	2012/2015	2009	2012/2015
1	0.065	0.041	0.041	R-19	R10 + R19 FC	R10 + R19 FC	0.167	0.115	0.115	R-6.0	R10	R10	0.065	0.044	R-19	R19 + R11 Ls		
2	0.055	0.041	0.041	R13 + R13	R10 + R19 FC	R10 + R19 FC	0.097	0.096	0.096	R-10	R16	R16	0.055	0.035	R13 + R13	R19 + R11 Ls		
3	0.055	0.041	0.041	R13 + R13	R10 + R19 FC	R10 + R19 FC	0.097	0.096	0.096	R-10	R16	R16	0.055	0.035	R13 + R13	R19 + R11 Ls		
4	0.055	0.037	0.037	R13 + R13	R19 + R11 Ls or R25 + R8 Ls	R19 + R11 Ls or R25 + R8 Ls	0.097	0.082	0.082	R-10	R19	R19	0.055	0.035	R13 + R13	R19 + R11 Ls		
5	0.055	0.037	0.037	R13 + R13	R19 + R11 Ls or R25 + R8 Ls	R19 + R11 Ls or R25 + R8 Ls	0.083	0.082	0.082	R13	R19	R19	0.055	0.035	R13 + R13	R19 + R11 Ls		
6	0.049	0.031	0.031	R19 + R13	R25 + R11 Ls	R25 + R11 Ls	0.072	0.060	0.060	R16	R19 + R19	R19 + R19	0.049	0.031	R19 + R13	R25 + R11 Ls		
7	0.049	0.029	0.029	R19 + R13	R30 + R11 Ls	R30 + R11 Ls	0.072	0.037	0.037	R16	R19 + R11 Ls or R25 + R8 Ls	R19 + R11 Ls or R25 + R8 Ls	0.049	0.029	R19 + R13	R30 + R11 Ls		
8	0.035	0.026	0.026	R19 + R11 Ls	R25 + R11 + R11 Ls	R25 + R11 + R11 Ls	0.065	0.037	0.037	R19	R19 + R11 Ls or R25 + R8 Ls	R19 + R11 Ls or R25 + R8 Ls	0.035	0.029	R19 + R11	R30 + R11 Ls		

1. R-5 thermal spacer block  
 "FC" = filled cavity; "Ls" = liner system; c.i. = continuous insulation

**Table 2 - Wall Assembly Requirements**

Climate Zone	ASHRAE 90.1												IECC			
	Nonresidential (conditioned)						Semiheated						Metal Building Walls (Above Grade)			
	Assembly U-factor			Insulation R-value			Assembly U-factor			Insulation R-value			Assembly U-factor		Insulation R-value	
	2010	2013	2016	2010	2013	2016	2010	2013	2016	2010	2013	2016	2009	2012/2015	2009	2012/2015
1	0.093	0.094	0.094	R-16	R0 + R9.8 c.i.	R0 + R9.8 c.i.	0.113	0.352	0.352	R13	NR	NR	0.093	0.079	R-16	R-13 + R6.5 c.i.
2	0.093	0.094	0.094	R-16	R0 + R9.8 c.i.	R0 + R9.8 c.i.	0.113	0.162	0.162	R13	R13	R13	0.093	0.079	R-16	R-13 + R6.5 c.i.
3	0.084	0.094	0.094	R19	R0 + R9.8 c.i.	R0 + R9.8 c.i.	0.113	0.162	0.162	R13	R13	R13	0.084	0.079	R-19	R-13 + R6.5 c.i.
4	0.084	0.060	0.060	R19	R0 + R15.8 c.i.	R0 + R15.8 c.i.	0.113	0.162	0.162	R13	R13	R13	0.084	0.052	R-19	R-13 + R13 c.i.
5	0.069	0.050	0.050	R13 + R5.6 c.i.	R0 + R19.8 c.i.	R0 + R19.8 c.i.	0.113	0.094	0.094	R13	R0 + R9.8 c.i.	R0 + R9.8 c.i.	0.069	0.052	R13 + R5.6 c.i.	R-13 + R13 c.i.
6	0.069	0.050	0.050	R13 + R5.6 c.i.	R0 + R19.8 c.i.	R0 + R19.8 c.i.	0.113	0.094	0.094	R13	R0 + R9.8 c.i.	R0 + R9.8 c.i.	0.069	0.052	R13 + R5.6 c.i.	R-13 + R13 c.i.
7	0.057	0.044	0.044	R19 + R5.6 c.i.	R0 + R22.1 c.i.	R0 + R22.1 c.i.	0.113	0.072	0.072	R13	R0 + R13 c.i.	R0 + R13 c.i.	0.057	0.052	R19 + R5.6 c.i.	R-13 + R13 c.i.
8	0.057	0.039	0.039	R19 + R5.6 c.i.	R0 + R25 c.i.	R0 + R25 c.i.	0.113	0.060	0.060	R13	R0 + R15 c.i.	R0 + R15 c.i.	0.057	0.052	R19 + R5.6 c.i.	R-13 + R13 c.i.

"c.i." = continuous insulation; "NR" = no (insulation) requirement

**Table 3 - Roof Assembly U-factors<sup>1</sup>**

Insulation System	Insulation Rated R-value	Overall Assembly U-factor
Filled Cavity with Thermal Spacer Blocks <sup>c</sup>		
	R-10 + R-19	0.041
	R-19 + R-11	0.037
Standing Seam Roof without Thermal Spacer Blocks		
Liner System	R-19 + R-11	0.04
Through-Fastened Roof without Therm. Spacer Blocks		
	R-10	0.184
	R-11	0.182
	R-13	0.174
	R-16	0.157
	R-19	0.151
Liner System	R-19 + R-11	0.044

(Multiple R-values are listed in order from inside to outside)

- From ASHRAE Std. 90.1-2016; Table A2.3.3, Assembly U-factors for Metal Building Roofs
  - A standing seam roof clip that provides a min. 1.5 in. distance between the top of the purlins and the underside of the metal roof panels is required
  - A minimum R-3 thermal spacer block is required
  - A minimum R-5 thermal spacer block is required

**Table 4 - Wall Assembly U-factors<sup>1</sup>**

Insulation System	Insulation Rated R-value	Overall Assembly U-factor
Single Compressed Layer		
	R-10	0.186
	R-11	0.185
	R-13	0.162
	R-16	0.155
	R-19	0.147
Single Layer in Cavity		
	R-25 <sup>a</sup>	0.059
	R-30 <sup>b</sup>	0.052
Double Layer		
	R-25 + R-10	0.047
	R-25 + R-16	0.042
	R-25 + R-10 <sup>c</sup>	0.039
	R-30 + R-16	0.039

(Multiple R-values are listed in order from inside to outside)

- From ASHRAE Std. 90.1-2016; Table A2.3.3, Assembly U-factors for Metal Building Walls
  - A minimum R-0.375 thermal spacer block or thermal break strip is required when installed w/out cont. insulation
  - A minimum R-0.75 thermal spacer block or thermal break strip is required when installed w/out cont. insulation
  - A minimum R-3 thermal spacer block is required

**Disclaimer of Liability**

Technical information contained herein is furnished without charge or obligation and is given and accepted at recipient's sole risk. Because conditions of use may vary and are beyond our control, Owens Corning makes no representation about, and is not responsible or liable for the accuracy or reliability of data associated with particular uses of any product described herein. SCS Global Services provides independent verification of recycled content in building materials and verifies recycled content claims made by manufacturers. For more information, visit [www.SCSglobalservices.com](http://www.SCSglobalservices.com). LEED® is a registered trademark of the U.S. Green Building Council.



**OWENS CORNING INSULATING SYSTEMS, LLC**  
 ONE OWENS CORNING PARKWAY  
 TOLEDO, OHIO, USA 43659  
**1-800-GET-PINK®**  
[www.owenscorning.com](http://www.owenscorning.com)

Pub. No. 10015581-G. Printed in U.S.A. March 2018.  
 THE PINK PANTHER™ & © 1964–2018 Metro-Goldwyn-Mayer Studios Inc.  
 All Rights Reserved. The color PINK is a registered trademark of Owens Corning.  
 © 2018 Owens Corning. All Rights Reserved.

